

RESCUE AND ASSISTANCE / REENTRY LOCKER - DC

AEL Range: 2-880044218

Utilize onboard material to build this kit. A laminated inventory list should be provided with this kit. Use AEL-2-880044218 to verify quantity for specific ship class.

R & A / REENTRY LOCKER


Quantity
Required

BLANKET - BED GY 60" x 84"

NSN 7210-00-082-5668

WT. 3.0 lbs VOL. 640.0 in³

Helpful Hints:

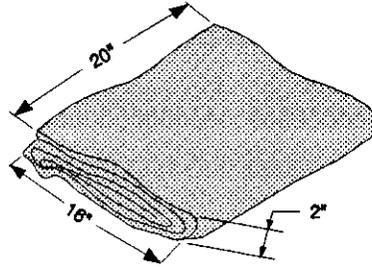

QAR


Actual Inventory:

**EXTINGUISHER - FIRE
CO₂ 15 LB. PORTABLE
SHIPBOARD USE.**

NSN 4210-00-203-0217

WT. 50.0 lbs. VOL. 3000.0 in.³

Helpful Hints: Non-magnetic extinguisher - optional for M-type ships.



QAR


Actual Inventory:

**EXTINGUISHER - FIRE
PKP - 18 LB. PORTABLE
MAGNETIC**

NSN 4210-00-989-4589

WT. 52.5 lbs. VOL. 3,632.8 in.³

Helpful Hints: Non-magnetic extinguisher - optional for M-type ships.



QAR

Actual Inventory:


R & A / REENTRY LOCKER

Quantity
Required

**FLAGS - COMMUNICATION
PROVIDED BY OPS DEPT
(RESCUE & ASSISTANCE)**

NSN 8345-00-946-7899

WT. 0.5 lbs. VOL. 20.0 in³

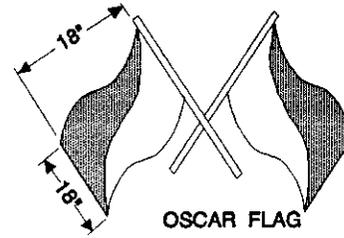

QAR

Helpful Hints:

It should be relocated to passageway to provide immediate access for Repair Party Personnel.
PMS due date _____

Actual Inventory:

KIT - DESMOKING EQUIPMENT

1H 0000-LL-CQA-2446

QAR

This kit identifies all equipment used for the function of conducting desmoking operations during and after a fire. Individual items are listed on AEL #2-880044238.

KIT - DEWATERING EQUIPMENT

1HM 0000-LL-CQA-2447

QAR

This kit identifies all equipment used for the function of conducting dewatering operations during and after flooding or firefighting. Individual items are listed on AEL #2-880044240.

KIT - ELECTRICAL REPAIR-DC

1H 0000-LL-CQA-2449

QAR

Used in damage control repair stations by qualified repair party electricians, this kit identifies all equipment used for the function of providing repairs to electrical panels, lighting, wireways and portable electrical equipment. Individual items are listed on AEL #2-880044244.

KIT - EMERGENCY COMM-DC

1H 0000-LL-CQA-2451

QAR

This kit identifies all equipment used for the function of providing emergency communications at battle stations or other general shipboard casualties. Individual items are listed on AEL #2-880044246.

R & A / REENTRY LOCKER

Quantity
Required

KIT - EMERGENCY LIGHTING - DC

QAR

1H 0000-LL-CQA-2452

This kit identifies all equipment used for the function of providing extension cables and lights where power supply has been interrupted. This is used during shipboard casualties and Condition 1. Individual items are listed on AEL #2-880044248.

**KIT - FIRE FIGHTING/ACCESS
EQUIPMENT-DC**

QAR

1H 0000-LL-CQA-2454

This kit identifies all equipment used for the function of providing access to fire areas. Individual items are listed on AEL #2-880044252.

**KIT - FIRE FIGHTING/ACCESS
PERSONNEL - DC**

QAR


1H 0000-LL-CQA-2455

This kit identifies all equipment used for the function of providing personnel protection to the fire fighter. Individual items are listed on AEL #2-880044254.

KIT - FIRST AID

NSN 6545-00-116-1410

WT. 10.0 lbs. VOL. 26.9 in³

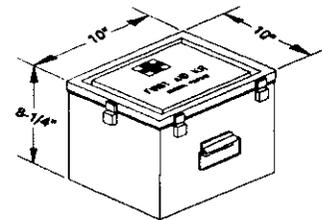

QAR

Helpful Hints:

A laminated kit inventory should be with this kit.

Actual Inventory:

KIT - GAS FREE ENGINEER-DC

QAR

1H 0000-LL-CQA-2456

This kit identifies all equipment used for the function of detecting the presence of poisonous and volatile fumes and gas, and to determine oxygen deficiency in a given compartment. Individual items are listed on AEL #2-880044260.

Actual Inventory:

R & A / REENTRY LOCKER

Quantity
Required

KIT - INVESTIGATOR - DC

1H 0000-LL-CQA-2457

QAR

This kit identifies all equipment used for the function of performing the preliminary survey of a known or suspected damage/fire/flooding area. Individual items are listed on AEL #2-880044262.

KIT - LOW PRESSURE BOUNDARY COOLING-DC

1H 0000-LL-CQA-2458

QAR

This kit identifies all equipment used for the function of boundary cooling. Individual items are listed on AEL #2-880044264. AEL number replaces deleted L.P. Air Line Jumper Kit.

**KIT - PORTABLE PUMP
ACCESSORIES-DC**

1H 0000-LL-CQA-2460

QAR

This kit identifies all equipment used for the function of providing accessories to the P-250 (MOD 1 & MOD 2) and P-100 pumps to function as a dewatering/fire fighting pump. Individual items are listed on AEL #2-880044270.

KIT - PIPE PATCHING-DC

1HM0000-LL-CQA-0095

QAR

This kit identifies all equipment used for the function of providing emergency pipe repair on L.P. systems. Individual items are listed on AEL #2-880044268.

KIT - PLUGGING-DC

1HM0000-LL-CQA-0102

QAR

This kit identifies all equipment used for the function of providing emergency hull/bulkhead plugging repair and split seam repair caulking. Individual items are listed on AEL #2-880044272.

R & A / REENTRY LOCKER

Quantity
Required

**KIT - PORTABLE EXOTHERMIC
CUTTING UNIT (PECU)-DC**

QAR

NSN 4240-01-272-3841

The PECU will replace existing portable oxyacetylene cutting units on a one for one basis. The PECU will provide for more rapid access into areas of the ship where normal access is impaired for fire fighting operations, and to drain accumulated firefighting water from areas of the ship where the effects of the accumulated firefighting water will impair the ship's stability. The PECU utilizes expendable cutting rods which operate on the exothermic torch principle. This principle involves the use of oxygen which is combined with a fuel. In this case the fuel is a steel tube. The exothermic cutting rod is ignited when the oxygen passing through the iron rod comes in contact with a spark generated from a 12 volt DC battery powered igniter. This kit identifies all equipment used for the function of cutting through ferrous and non-ferrous wiring and other shipboard materials, particularly aircraft carrier flight decks. Individual items are listed on AEL #2-880044274.

Helpful Hints:

KIT - RESCUE AND ASSIST-DC

QAR

1H 0000-LL-CQA-2464


This kit identifies all equipment used for the function of providing off ship assistance at sea or in port to conduct fire fighting, dewatering or personnel rescue operations. Individual items are listed on AEL #2-880044279.

**LIGHT - HAND HELD
(SIGNAL)**

NSN 5850-00-501-1455

WT. 3.0 lbs. VOL. 386.4 in³

Helpful Hints: Provided by Operations Dept.

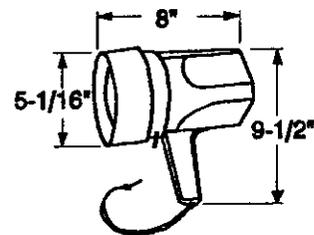


QAR

LITTER - RIGID, STOKES

NSN 6530-01-315-4784

WT. 34.0 lbs. VOL. 14,490.0 in³

Helpful Hints: Provided by Medical Dept.

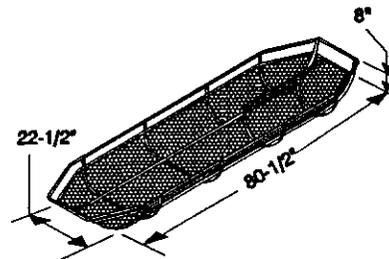

QAR

R & A / REENTRY LOCKER


Quantity
Required

PISTOL - VARY

NSN 1095-00-726-5820

WT. 2.0 lbs.

VOL. 84.0 in³

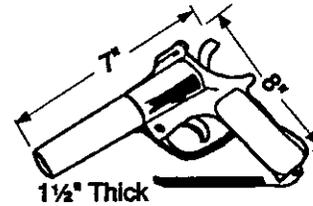

QAR

Helpful Hints: Provided by Weapons Dept.



PP-BOOTS - FIREMAN

1H 0000-LL-CJ6-8462

SELECT SIZE

NSN 8430-00-753-5935

SIZE 05

NSN 8430-00-753-5936

SIZE 06

NSN 8430-00-753-5937

SIZE 07

NSN 8430-00-753-5938

SIZE 08

NSN 8430-00-753-5939

SIZE 09

NSN 8430-00-753-5940

SIZE 10

NSN 8430-00-753-5941

SIZE 11

NSN 8430-00-753-5942

SIZE 12

NSN 8430-00-753-5943

SIZE 13

NSN 8430-00-753-5944

SIZE 14


NSN 8430-00-753-5945

SIZE 15

(PAIR)

WT. 6.7 lbs

VOL. 3,935.2 in³

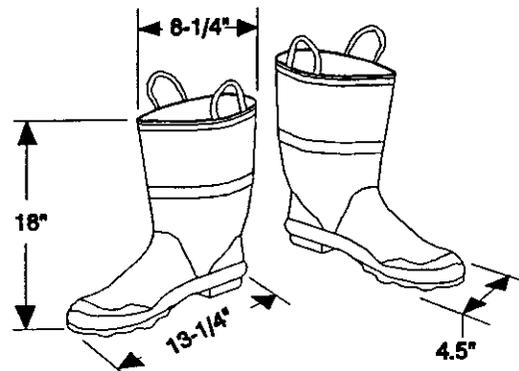

Helpful Hints: Each OBA should have boots available. Can be stowed with OBAs or in DCRS. Fireman boots are authorized for use by Repair Party Electricians (Nov 86 NAVSHIPS Safety Bulletin).

Actual Inventory:

R & A / REENTRY LOCKER


Quantity
Required

PP-BREATHING APPARAT - A-4

NSN 4240-00-616-2857

WT. 15.5 lbs

VOL. 3,366.0 in³

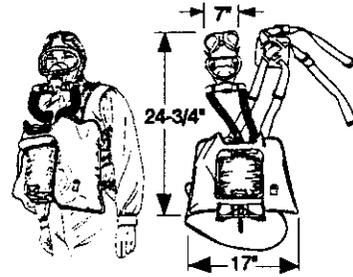

QAR

Helpful Hints: PP-COVER-LENS for OBA face piece (NSN 4240-01-052-9901) 1 package required. PP-WRENCH, SPANNER (NSN 5120-01-290-1804) for OBA, used to remove valve cap for replacing diaphragms and gaskets.

Actual Inventory:


PP-CANISTER - OXYGEN GEN
(GREEN)

NSN 4240-00-174-1365

(BOX OF 6 CANISTERS)

WT. 4.0 lbs

VOL. 178.1 in³

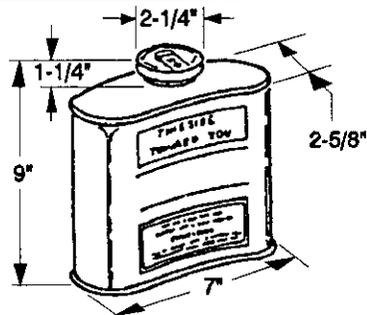

QAR

Helpful Hints: Allowance of canisters for all ships is twelve each for one breathing apparatus, six as ready service and six as reserve. Ready service canisters shall be stowed with their respective OBAs. Reserve canisters shall be stowed in repair stations, weather access reentry stowage spaces or other readily accessible locations on or above the damage control deck as approved by the supervisor. Reserve canisters may be stowed in their original shipping containers. Canisters for shipboard use must be equipped with A2 pc cap.

Actual Inventory:

R & A / REENTRY LOCKER

Quantity
Required

PP-COVERALLS - - FIRE RET

MENS

1H 0000-LL-CJA-1091 (SELECT SIZE)

NSN 8405-01-286-6336 SIZE 36S

NSN 8405-01-286-6337 SIZE 36R

NSN 8405-01-286-6338 SIZE 38S

NSN 8405-01-286-6339 SIZE 38R

NSN 8405-01-286-6340 SIZE 38L

NSN 8405-01-286-6341 SIZE 40S

NSN 8405-01-286-6342 SIZE 40R

NSN 8405-01-286-6343 SIZE 40L

NSN 8405-01-286-6344 SIZE 42S


NSN 8405-01-286-6345 SIZE 42R

NSN 8405-01-286-6346 SIZE 42L

NSN 8405-01-286-6347 SIZE 44S

NSN 8405-01-286-6348 SIZE 44R

NSN 8405-01-286-6349 SIZE 44L

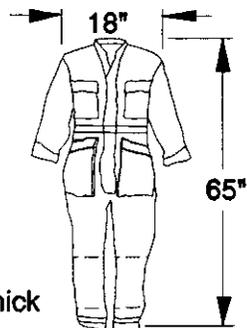

1/8" Thick

NSN 8405-01-286-6350 SIZE 46S

NSN 8405-01-286-6351 SIZE 46R

NSN 8405-01-286-6352 SIZE 46L

NSN 8405-01-286-6353 SIZE 48S

NSN 8405-01-286-6354 SIZE 48R

QAR

WT. AVG 1.0 LB

VOL. AVG 108.0 in³ (FOLDED 18"X12"X½")

Actual Inventory:


PP-GLOVES - ANTIFLASH

NSN 8415-01-267-9661

(PAIR)

WT. 1.0 oz

VOL. 11.3 in³

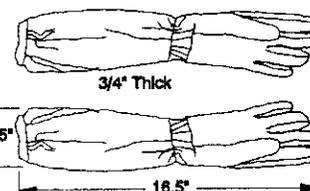

QAR

Helpful Hints:

Stored with life preserver.

Actual Inventory:

R & A / REENTRY LOCKER


Quantity
Required

PP-GLOVES - FIREMAN

1HM0000-LL-CQA-2201 SELECT SIZE
 NSN 8415-01-421-1368 SIZE SML
 NSN 8415-01-421-1371 SIZE MED
 NSN 8415-01-421-1373 SIZE LRG
 NSN 8415-01-421-1375 SIZE X-LRG
 NSN 8415-01-421-1376 SIZE XX-LRG
 (PAIR)

WT. 2.0 lbs.

VOL. 108.0 in³

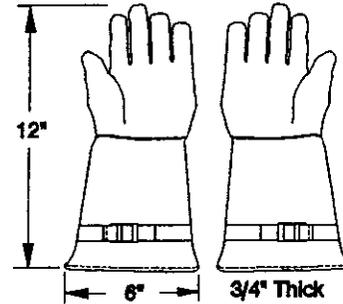

QAR

Helpful Hints: Used for each OBA. Replace stock when worn with new firefighter's glove which has an aluminized back & knit wristlet. NSN: 8415-01-335-7901 (XS) thru 8415-01-335-7905 (XL).


Actual Inventory:

PP-HELMET - FIREMAN

NSN 8415-01-271-8069

WT. 2.9 lbs

VOL. 1,320.0 in³

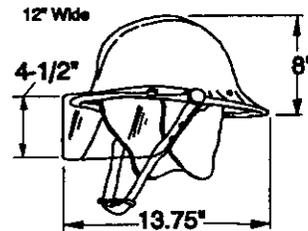

QAR

Helpful Hints: Stored in helmet rack in passageway, on hook, butterfly clips or designated stowage device.


Actual Inventory:

PP-HELMET - PHONE TALKER MARK 4 MOD 0

NSN 8470-01-127-7337

WT. 4.0 lbs.

VOL. 1,124.0 in³

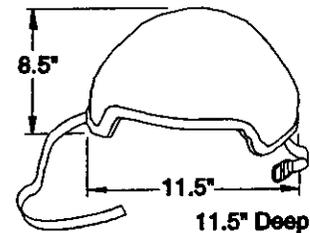

QAR

Helpful Hints: Stored in phone talker helmet rack in main DCRS or passageway.

Actual Inventory:

R & A / REENTRY LOCKER


Quantity
Required

PP-HOOD - ANTIFLASH

NSN 8415-01-268-3473

WT. 2.0 oz

VOL. 20.2 in³

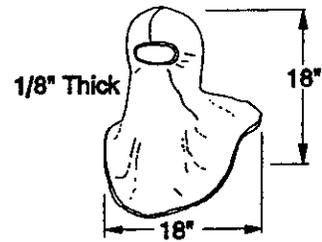

QAR

Helpful Hints:


Actual Inventory:

PP-LIFE PRESRVR - Y INFLAT

NSN 4220-00-289-1891

WT. 3.0 lbs.

VOL. 60.0 in³

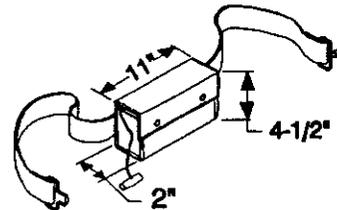


QAR

Helpful Hints: Should be stored with general quarters gear in passageway locker.

Actual Inventory:

PP-LANTERN HEAD - (USES FOUR SIZE AA BATTERIES)

NSN 6135-00-043-7845 SIZE AA BATTERIES
NSN 6230-01-285-4396 ASSEMBLY
PHILLIPS HPR-40 OR REPLACEMENT
OSRAM 640721 HALOGEN BULB

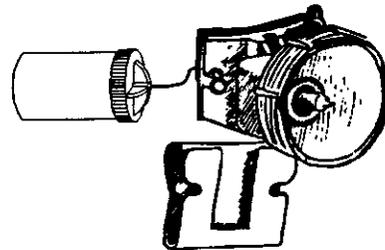

QAR

WT. 1.0 lbs

VOL. 117.0 in³

Helpful Hints:


Actual Inventory:

PUMP - P-100

NSN 6Y 4320-01-387-2869

WT. 165.0 bs

VOL. 12,091 in³

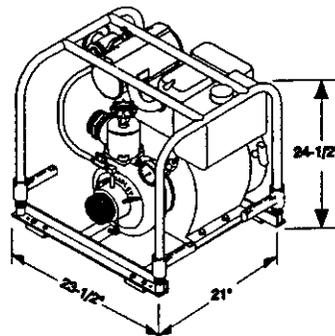

Helpful Hints: Exhaust hose 2" x 10' - qty 2 each.
This is the replacement for the P-250 pump.

Actual Inventory: